

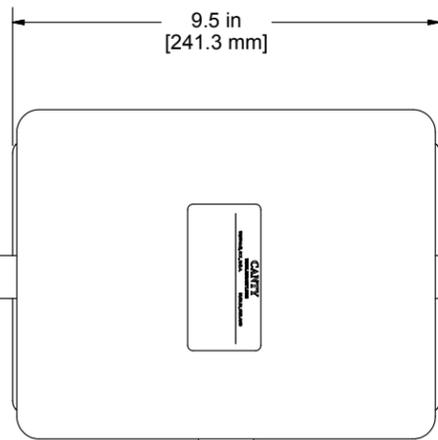
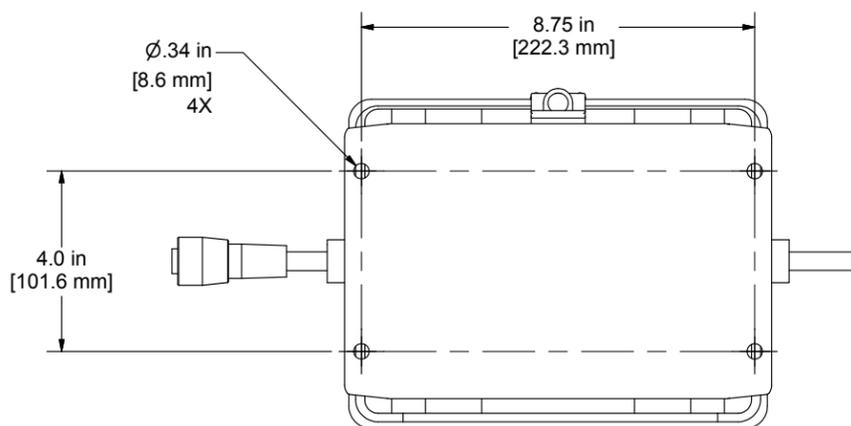


2 POLE MOLDED CONNECTOR. MATING CONNECTOR SUPPLIED ON CAMERA HOUSING. 12V DC CONNECTION NEMA 1,3,4,6P / IP67

19 FT. [6m], 2 CONDUCTOR MOLDED LEAD OUTPUT

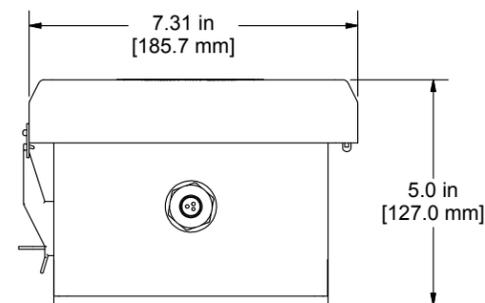

16 FT. [5m], 3 CONDUCTOR INPUT CABLE

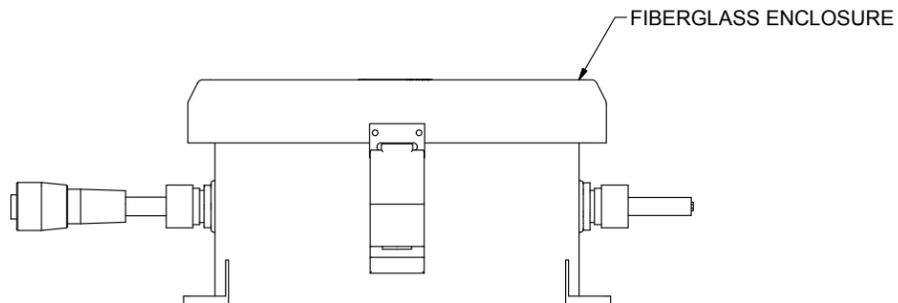

SPECIFICATIONS	
P/N	VC10454-140
MODEL	CAM. PSU, NEMA4X/IP66, 120V/230VAC IN, 12VDC OUT
INPUT SPECIFICATIONS	100 - 240V AC, 50/60 Hz, .45A
OUTPUT SPECIFICATIONS	12 VDC, 1A MAX.
FEATURES	
- NEMA TYPE 4X / IP66 ENCLOSURE.	
- MOLDED CORD END NEMA 1,3,4,6P / IEC IP67	
- MAX. RECOMMENDED DISTANCE BETWEEN PSU AND CAMERA IS 100 FT. [30.5 m]	

NOTES:

- ALL INFORMATION IS SUBJECT TO CHANGE WITHOUT NOTICE.
- APPROXIMATE WEIGHT 5 lb. [2.3 kg].

NOTICE
THIS DRAWING IS THE PROPERTY OF J.M. CANTY AND MUST BE RETURNED WITHOUT REPRODUCTION OR DUPLICATION, AT ANY TIME UPON REQUEST, BUT IN ANY EVENT AS SOON AS IT HAS SERVED THE PURPOSE FOR WHICH IT WAS FURNISHED. WHILE IN THE POSSESSION OF THE RECIPIENT, IT MUST BE PROPERLY SAFEGUARDED AGAINST DISCLOSURE TO ANYONE EXCEPT THOSE EMPLOYEES WHO REQUIRE IT FOR WORK OR JOB. THE RECIPIENT MUST KEEP CONFIDENTIAL AND REQUIRE HIS (HER) EMPLOYEES TO KEEP CONFIDENTIAL THE INFORMATION CONTAINED HERE ON.

IMPORTANT FOR THE REQUIRED MANUFACTURING SPECIFICATIONS SEE DOCUMENT #A4955

NOTE: FAILURE TO RECEIVE DOCUMENT DOES NOT WAIVE VENDOR RESPONSIBILITY

DRAWN BY	DATE
GKW	06-Oct-15
APPROVAL	DATE
GKW	06-Oct-15
ENGINEERING ANALYSIS	DATE
CURRENT	
MFG. APPROVAL	DATE
PENDING	
QUALITY CONTROL	DATE
I.O.A.	

J.M. CANTY INC. 6100 DONNER RD. BUFFALO, N.Y. 14094 U.S.A.		CANTY WWW.JMCANTY.COM	J.M. CANTY INTL. LTD. BALLYCOOLIN BUS. PK. BLANCHARDSTOWN DUBLIN 15, IRELAND	
TITLE CAMERA POWER SUPPLY SPEC., P/N VC10454-140, NEMA 4X / IP66, 120V/230 AC, 12V DC OUT				
REVISION	FILE NAME			
0	C11831			
SCALE AS NOTED	SIZE C	SHEET 1 OF 1		