


PROCESS AREA

SAFE AREA

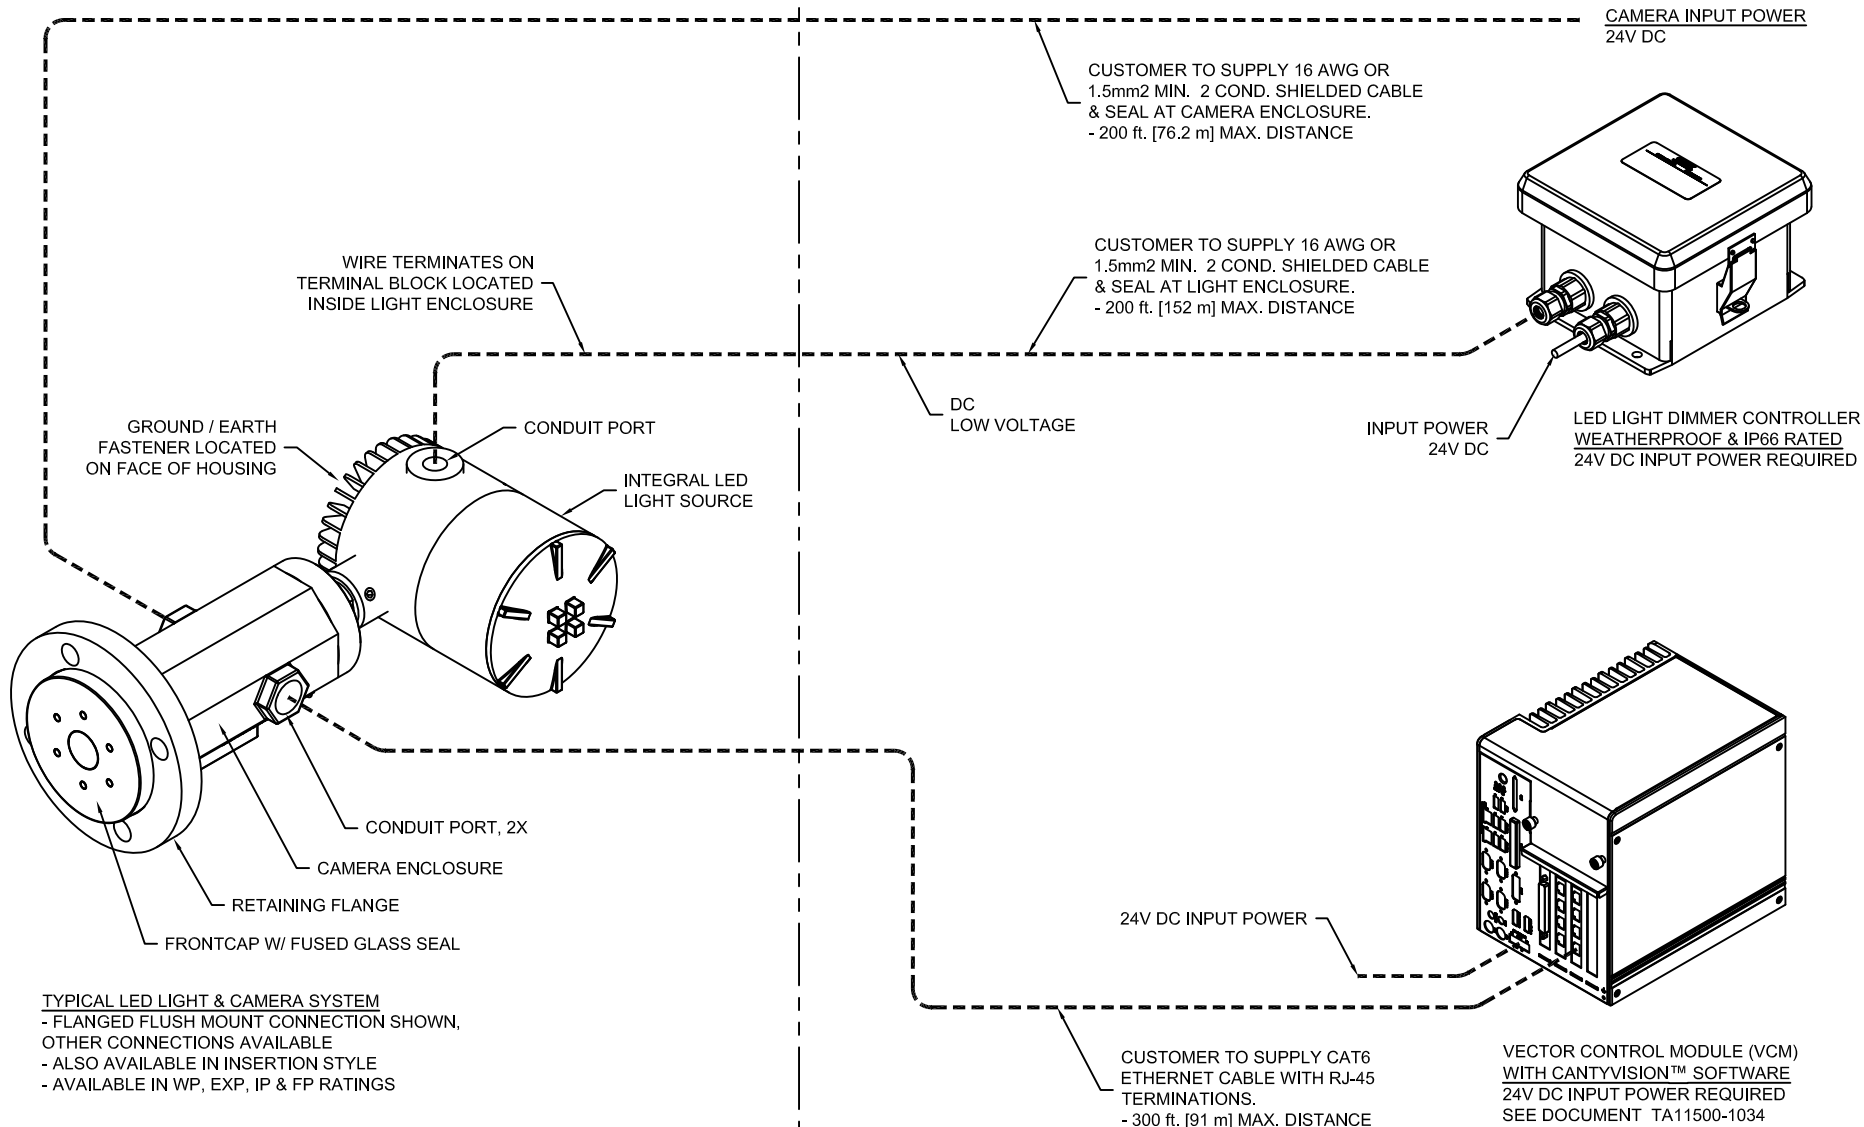

**TYPICAL LED LIGHT & CAMERA SYSTEM**  
 - FLANGED FLUSH MOUNT CONNECTION SHOWN,  
 OTHER CONNECTIONS AVAILABLE  
 - ALSO AVAILABLE IN INSERTION STYLE  
 - AVAILABLE IN WP, EXP, IP & FP RATINGS

**NOTES:**

1. ALL WIRING AND CONNECTORS ARE SUPPLIED BY CUSTOMER AND MUST BE COMPLETED IN ACCORDANCE WITH APPLICABLE REGULATIONS.
2. ETHERNET CAMERA IS CONNECTED TO CUSTOMER'S DEDICATED ETHERNET NETWORK VIA CAT6 ETHERNET CABLE. FOR LONG DISTANCES PLEASE CONTACT THE FACTORY FOR AVAILABLE ETHERNET CABLE TO FIBER CONVERTERS, SEE DOCUMENT TA11950-1024.
3. EACH VECTOR CONTROL MODULE (VCM) SYSTEM IS PROVIDED WITH 1 LICENSE OF CANTYVISION™ SOFTWARE.
4. CAMERA & LIGHT ARE PROVIDED WITH EXTERNAL EARTH CONNECTIONS.
5. ALL INFORMATION SUBJECT TO CHANGE WITHOUT NOTICE.

**NOTICE**  
 THIS DRAWING IS THE PROPERTY OF J.M. CANTY AND MUST BE RETURNED WITHOUT REPRODUCTION OR DUPLICATION, AT ANY TIME UPON REQUEST. BUT IN ANY EVENT AS SOON AS IT HAS SERVED THE PURPOSE FOR WHICH IT WAS FURNISHED, WHILE IN THE POSSESSION OF THE RECIPIENT, IT MUST BE PROPERLY SAFEGUARDED AGAINST DISCLOSURE TO ANYONE EXCEPT THOSE EMPLOYEES WHO REQUIRE IT FOR WORK OR JOB. THE RECIPIENT MUST KEEP CONFIDENTIAL AND REQUIRE HIS (HER) EMPLOYEES TO KEEP CONFIDENTIAL THE INFORMATION CONTAINED HERE ON.

**IMPORTANT**  
 FOR THE REQUIRED MANUFACTURING SPECIFICATIONS SEE DOCUMENT #A4955

**NOTE: FAILURE TO RECEIVE DOCUMENT DOES NOT WAIVE VENDOR RESPONSIBILITY**

DRAWN BY	DATE
GKW	17-Dec-19
APPROVAL	DATE
BLC	3-Feb-20
ENGINEERING ANALYSIS	DATE
CURRENT	
MFG. APPROVAL	DATE
PENDING	
QUALITY CONTROL	DATE
I.O.A.	

J.M. CANTY INC.  
 6100 DONNER RD.  
 BUFFALO, N.Y. 14094  
 U.S.A.

**CANTY**  
 WWW.JMCANTY.COM

J.M. CANTY INTL. LTD.  
 BALLYCOOLIN BUS. PK.  
 BLANCHARDSTOWN  
 DUBLIN 15, IRELAND

TITLE  
**TYPICAL ETHERNET PROCESS VISION SYSTEM, NON-INSERTION, LED LIGHT, DIMMER / VCM CPU / COMPONENT LAYOUT**

SIZE	REVISION	FILE NAME
C	0	TA11950-1037
SCALE	NTS	SHEET 1 OF 1